


1
2
3
4
5

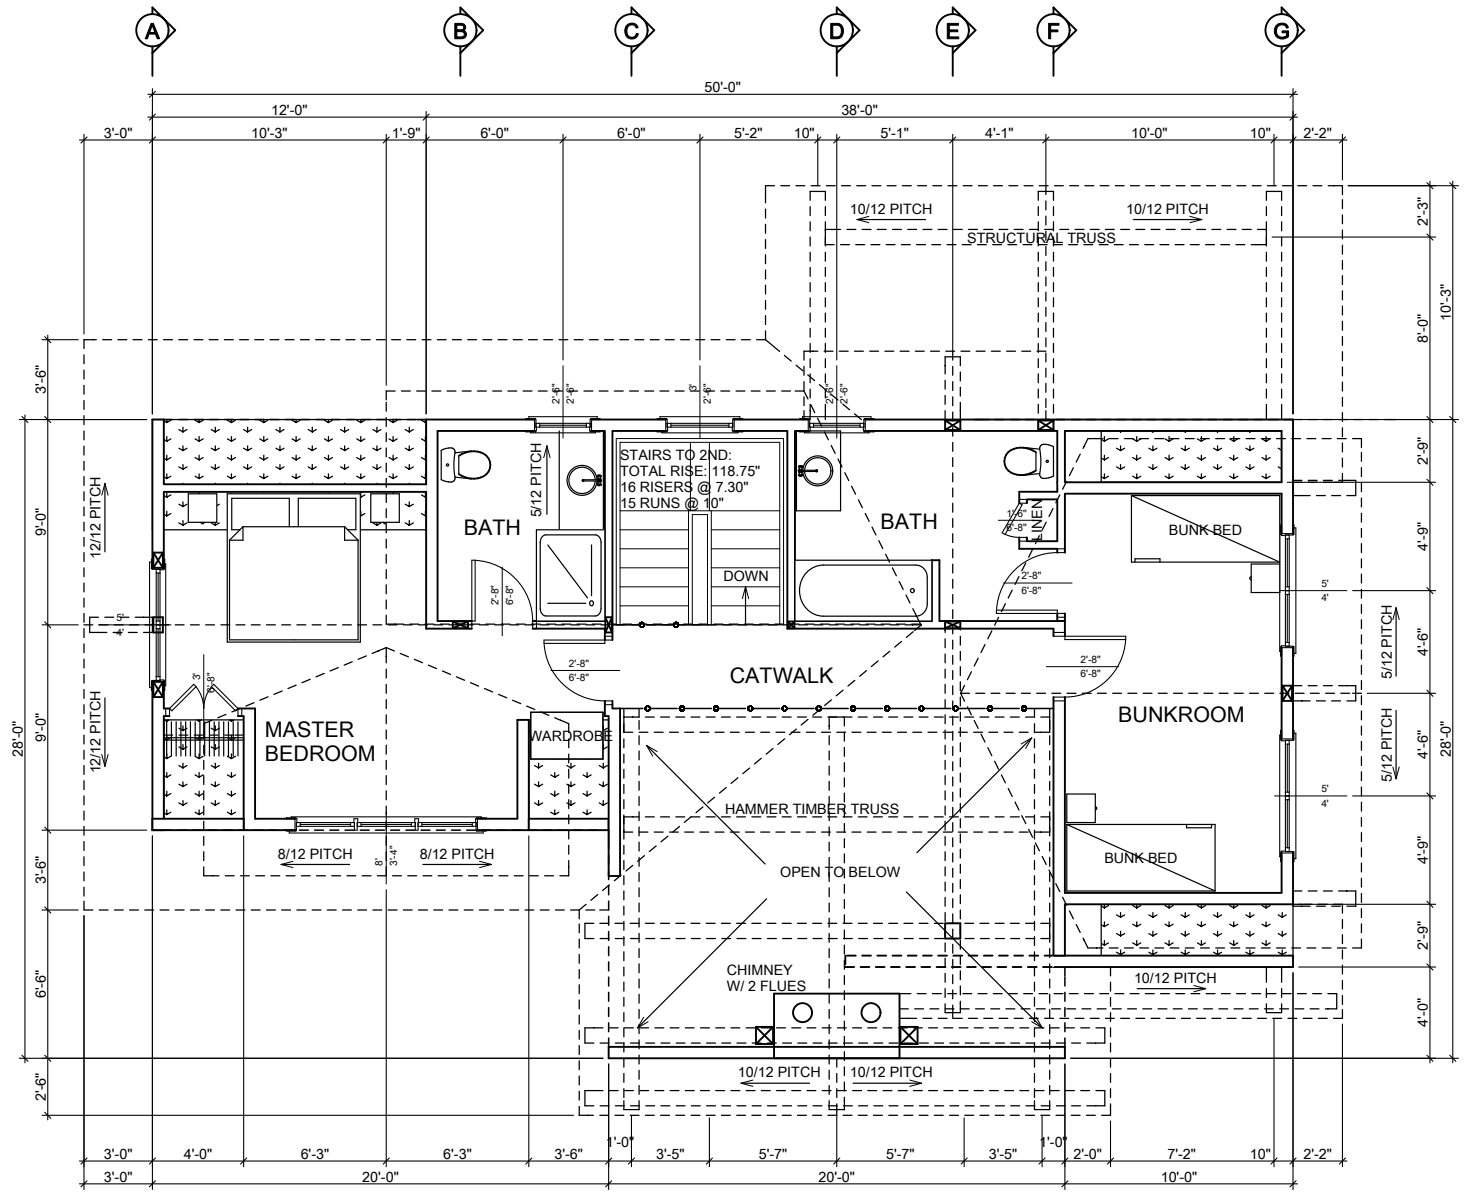

SECOND FLOOR PLAN

AREA: 644 SQ. FT.

SNOW LOAD: lbs/ SQ. FT.

EXT. WALLS TO BE:
CEDAR SHAKES
ON # 30 FELT
ON 7/16" O.S.B. SHEATHING
2X6 @ 16" O.C. FRAME WALL
R 19 BATT INSULATION
6 MIL POLY V.B.
INT. FINISH TO OWNERS SPECS.

BITUTHANE ICE & WATER
SHIELD INSTALLED FROM
EXTERIOR WALL LINE TO
MIN. 4' UP THE ROOF SLOPE
W/ 18" EACH WAY UP VALLEYS
UNDER VALLEY ROOF FLASHING

ROOF TO BE:
ASPHALT SHINGLES
ON ICE & WATER SHIELD OR #30 FELT
5/8" O.S.B. SHEATHING
W/ EDGE CLIPS BETWEEN RAFTERS
11 7/8" TJI @ 2' O.C. RAFTERS
R 38 MIN. BATT INSULATION
W/ 2.5" AIRSPACE (ROOF VENTILATION
FROM SCREENED VENTED FASCIA TO
VENTED RIDGE CAP)
6 MIL POLY V.B.
CLG. FINISH TO OWNERS SPECS.